


CT 400 Diagram

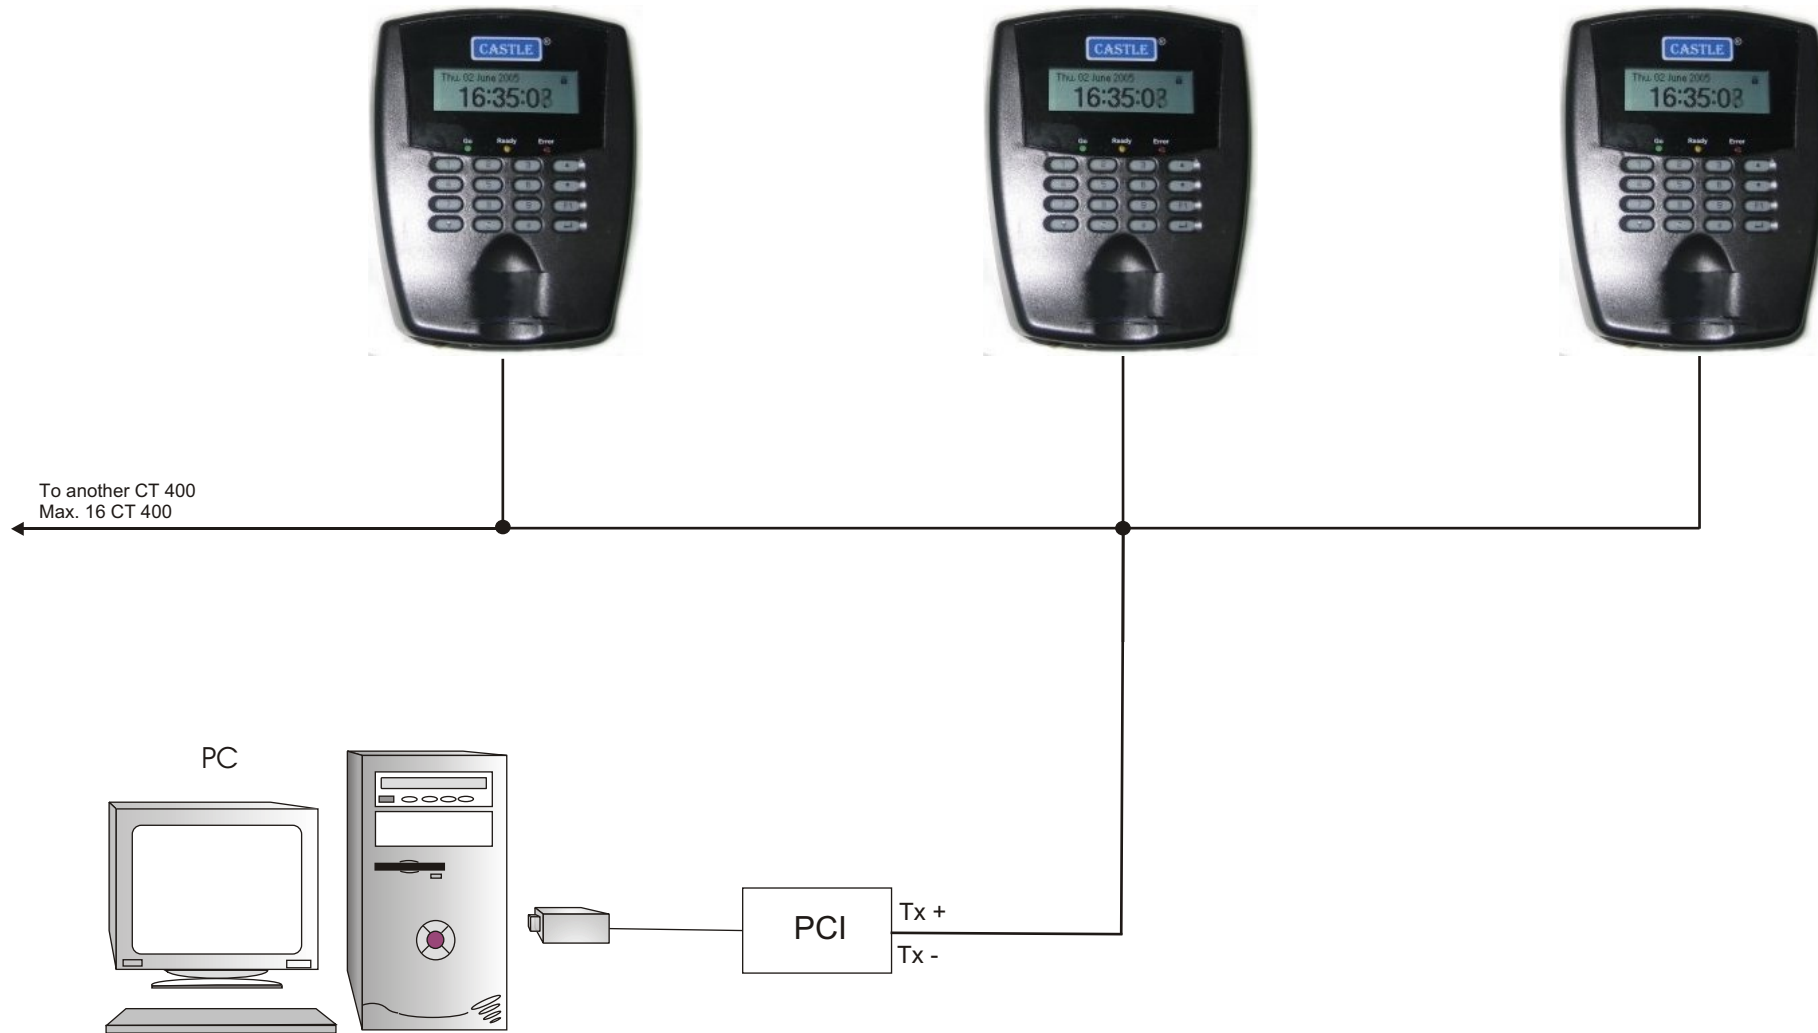

Remarks:

- For single of CT400, DIP switch need to be set to address '00'.
- For multiple of CT400, please refer to figure 1 for address setting.
- Controller address should not be set the same to avoid data corruption.
- All communication cable must be compliance RS485 standard, with proper grounding & connected in multidrop connection.

File	CT400 DIAGRAM v3
Date	200509
Company	Cass Technology Sdn Bhd